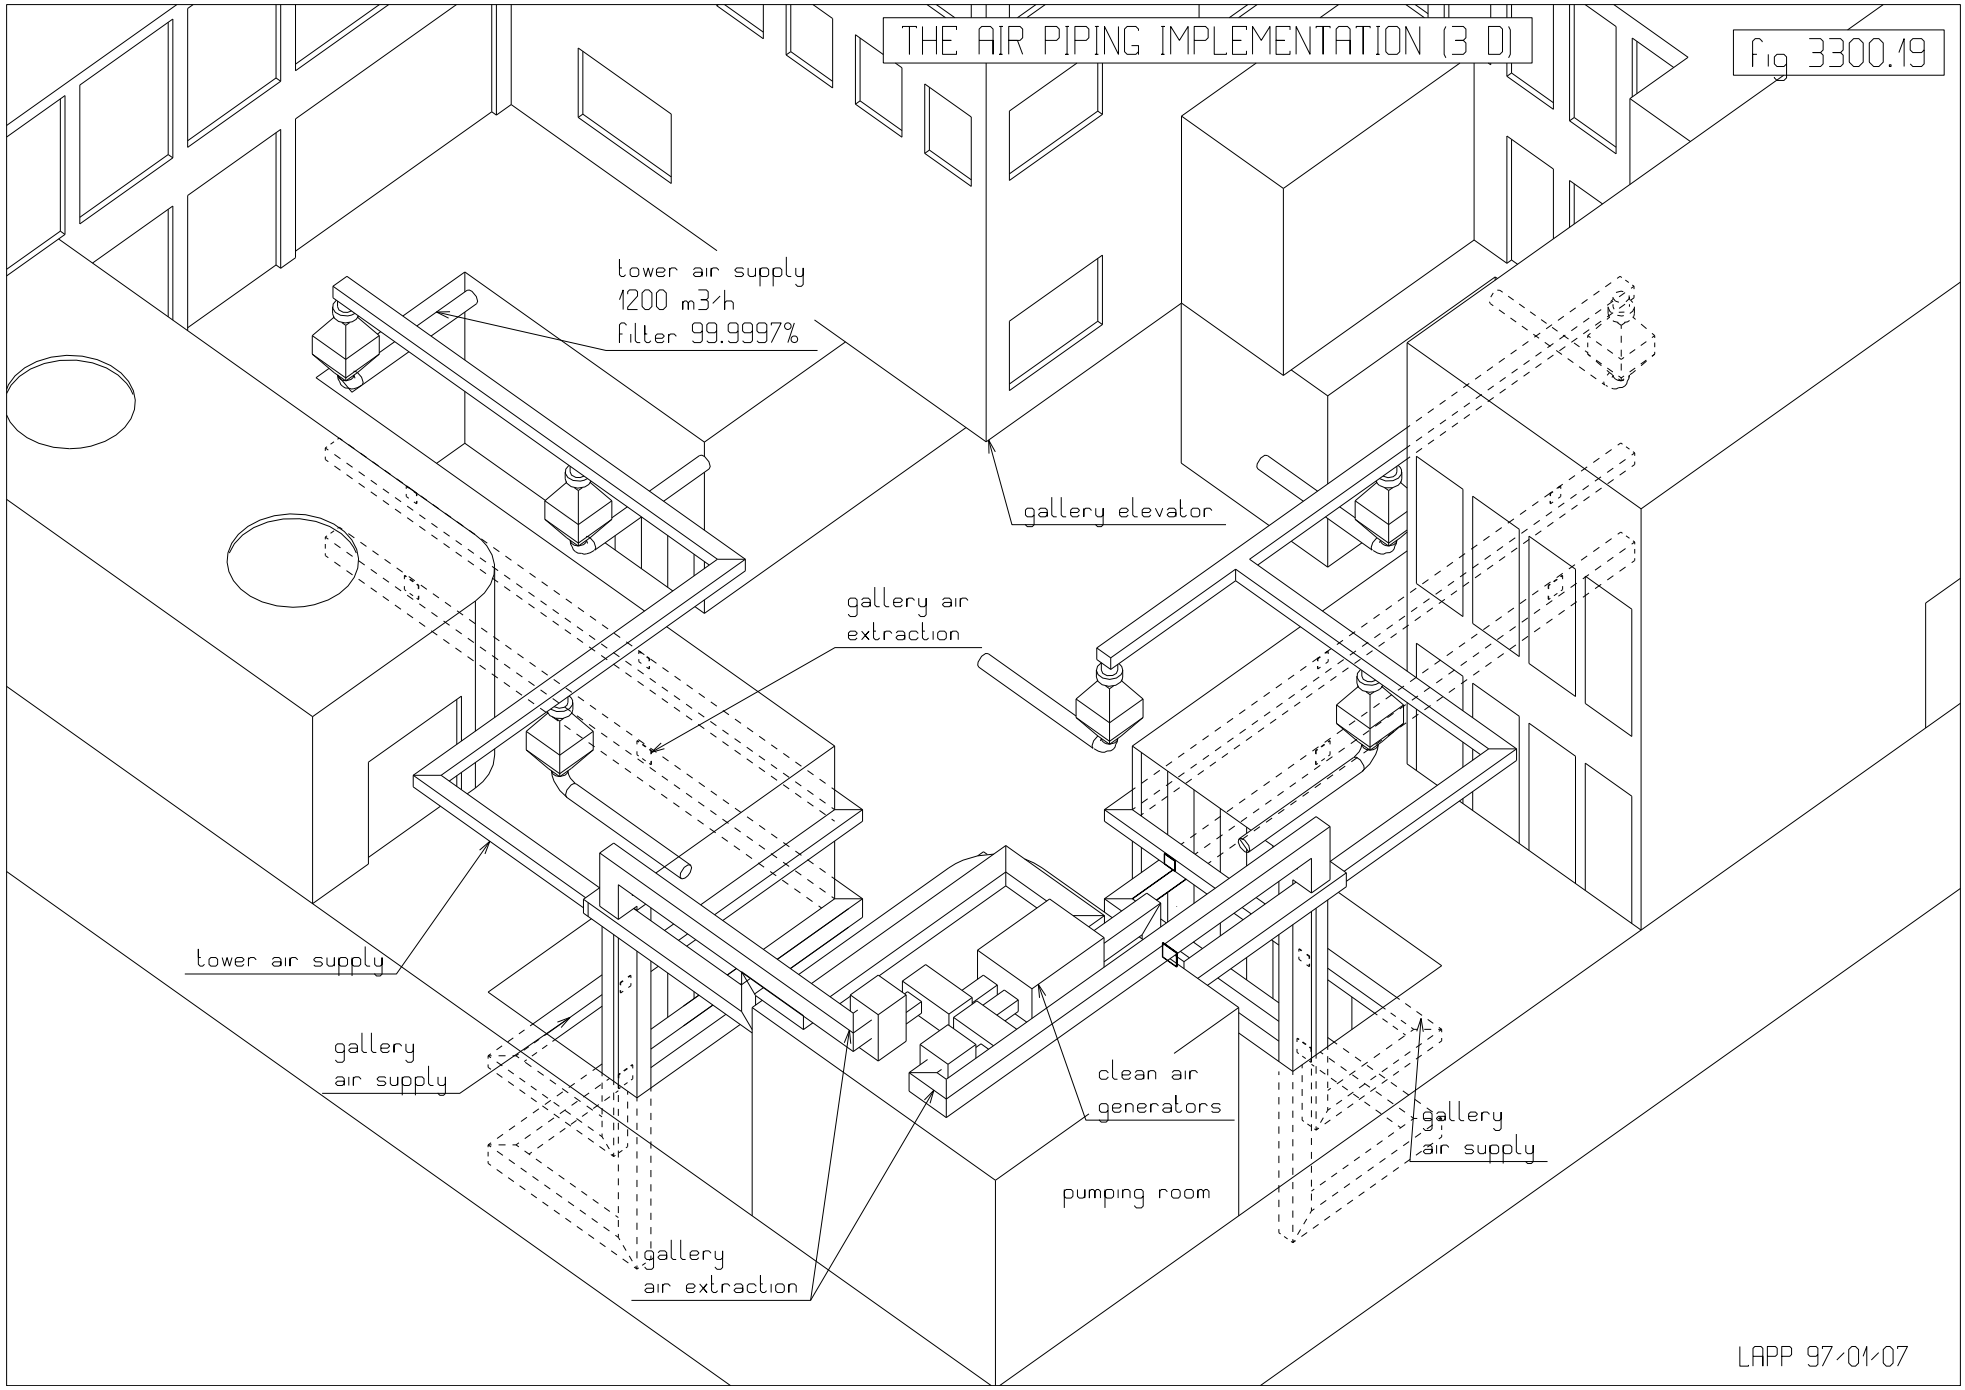
THE AIR PIPING IMPLEMENTATION (3 D)
fig 3300.19
tower air supply
1200 m3/h
filter 99.9997%
gallery elevator
gallery air
extraction
tower air supply
gallery
air supply
clean air
generators
gallery
air supply
pumping room
gallery
air extraction
LAPP 97-01-07