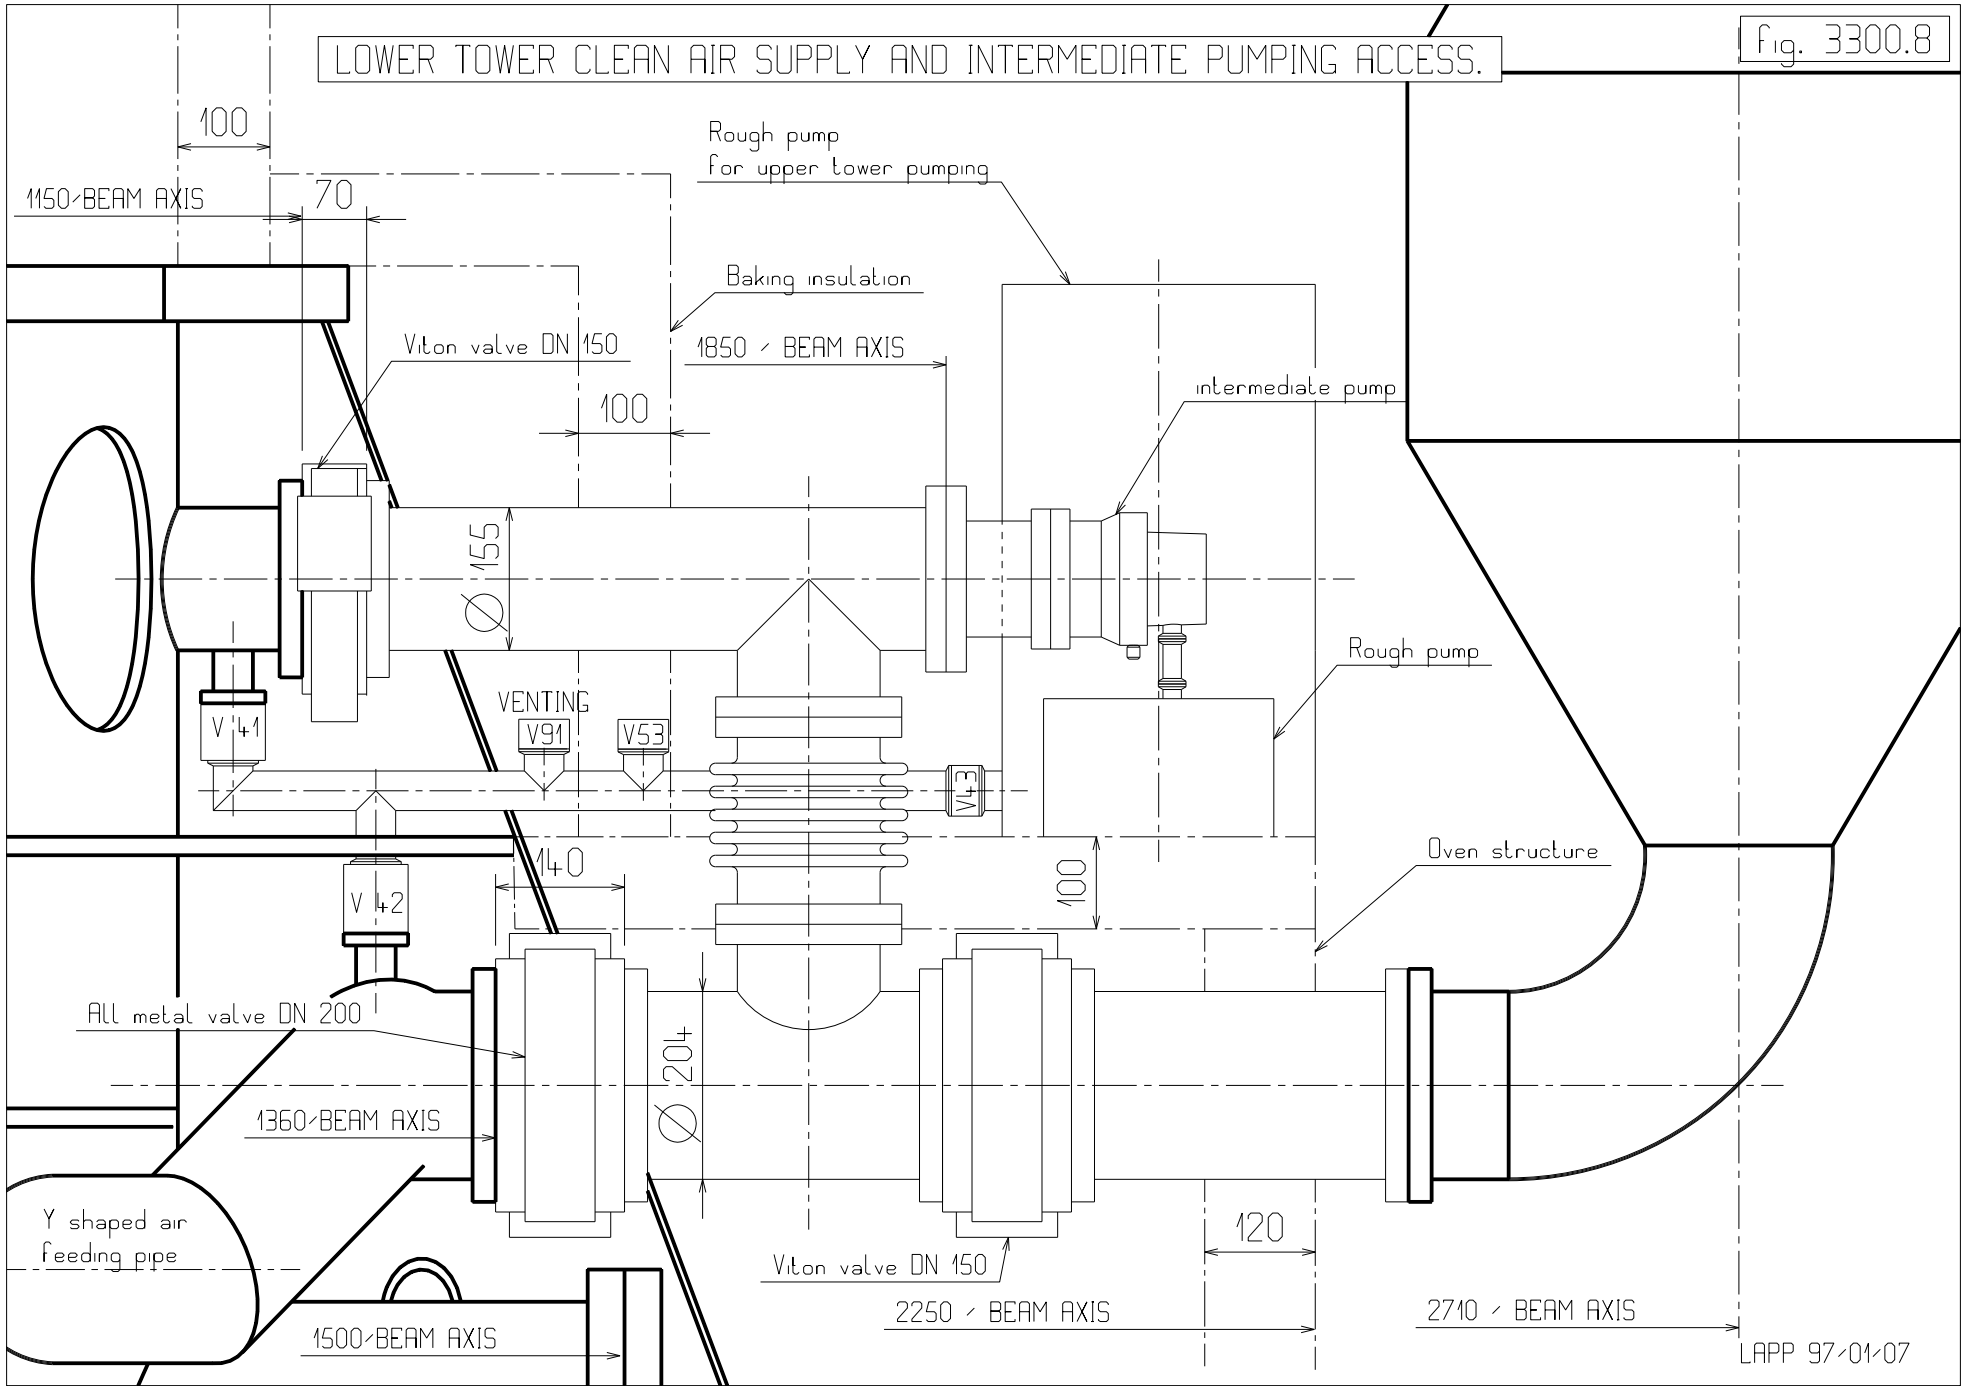
LOWER TOWER CLEAN AIR SUPPLY AND INTERMEDIATE PUMPING ACCESS.
Fig. 3300.8
100
1150/BEAM AXIS
70
Rough pump
for upper tower pumping
Baking insulation
Viton valve DN 150
1850 / BEAM AXIS
100
intermediate pump
155
Rough pump
VENTING
V 41
V91
V53
V43
140
100
Oven structure
V 42
All metal valve DN 200
204
1360/BEAM AXIS
Y shaped air
feeding pipe
120
Viton valve DN 150
2250 / BEAM AXIS
2710 / BEAM AXIS
1500/BEAM AXIS
LAPP 97/01/07